


### FOR HONEYWELL CONTROL, HONEYWELL GAS VALVE

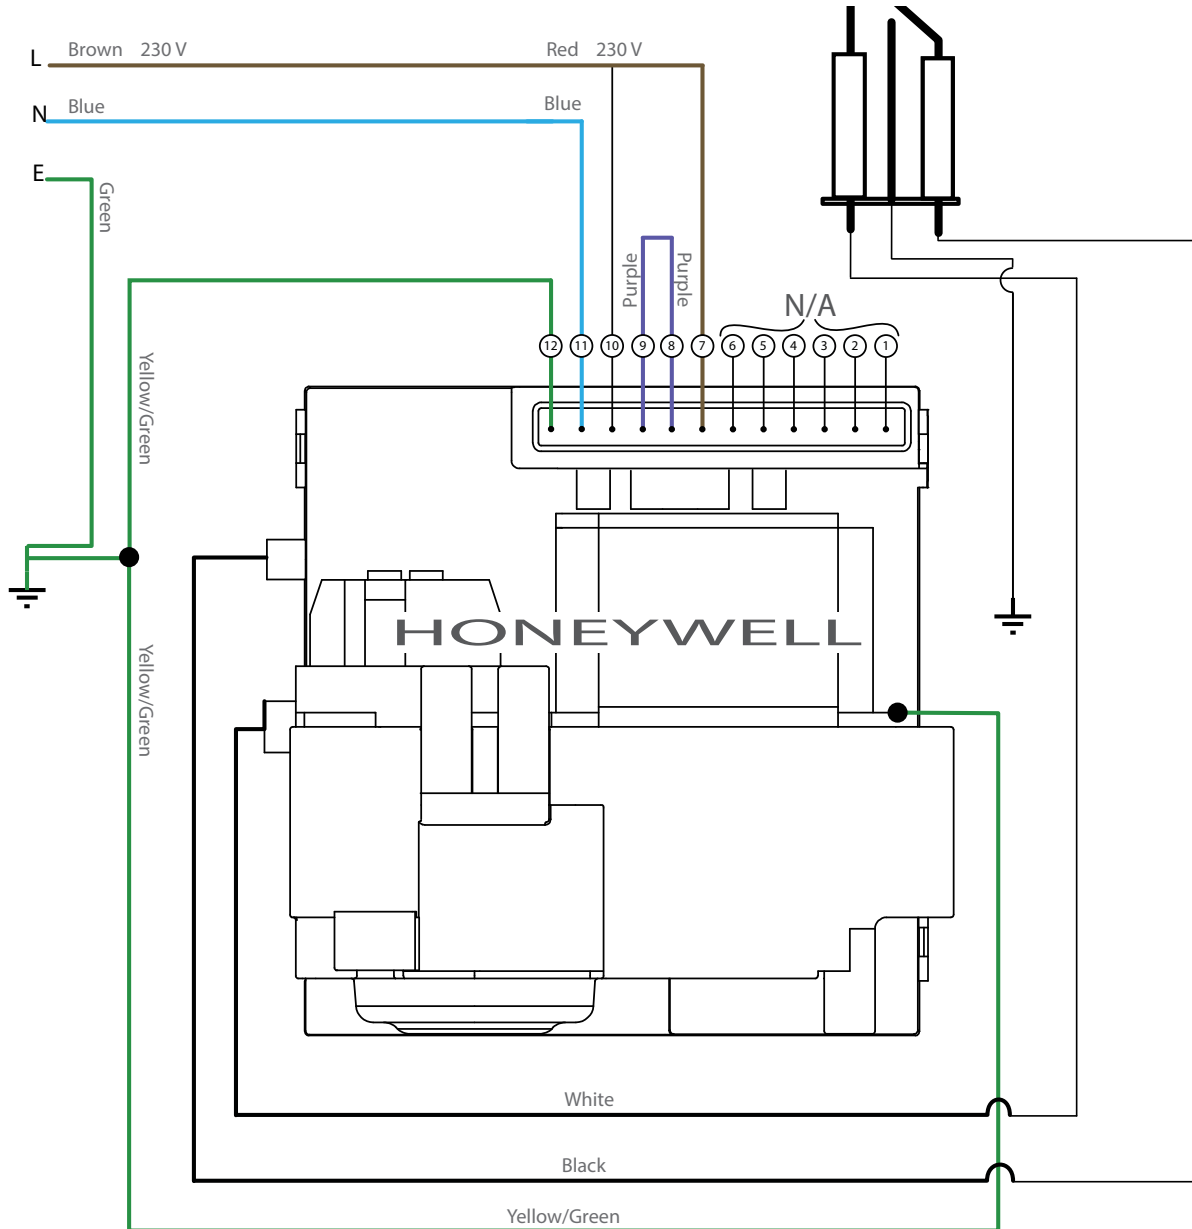

**NOTE:**

If any of the original wire as supplied with the heater must be replaced, it must be replaced with 18AWG, 90°C type UL approved wire or its equivalent. If Transformer must be replaced, a UL approved model of similar type must be used.